



Raised Storage and Fire Resistance

Case 1

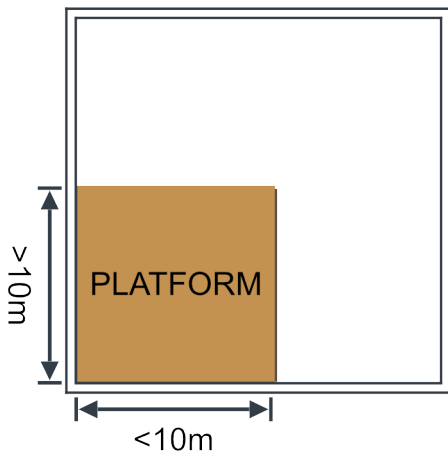


No protection required.

Case 2

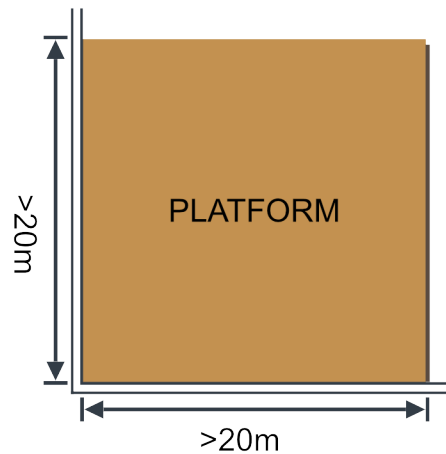

Smoke detection and alarm systems to the lower level (depending on other conditions).

Case 3

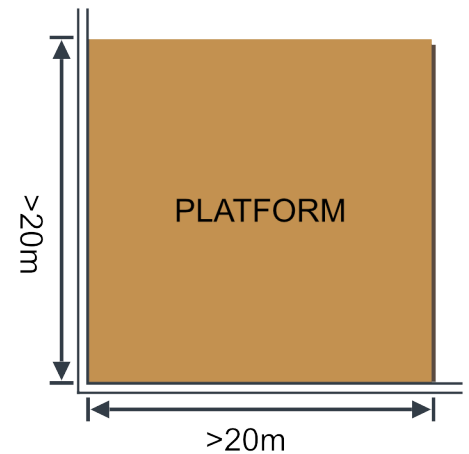

Sprinklers or fire resistance (depending on other conditions).

8.9 Conditions to Satisfy

A

The structure has only one tier and is used for storage purposes only.

E

The means of escape from the floor meets provisions in section 4, 5 and 6 of B1- horizontal escape.

B

The number of persons likely to be on a floor at any time is low and doesn't include public visitors.

C

The floor isn't >10m in either width or length and doesn't exceed one half of the location's floor space.

D

The floor is open above and below to the room or space in which it is situated.

Limitations on Travel Distance

	Maximum travel distance where travel is possible:	
	One direction only (m)	More than one direction (m)
Storage	25	45